


NOTE:

- EACH DRIVEWAY PANEL NOT TO EXCEED 100 SF.
- REINFORCEMENT BARS OR WELDED WIRE FABRIC (STEEL MESH) ARE NOT ALLOWED IN THE RIGHT-OF-WAY
- CLASS 5 AGGREGATE BASE REQUIRED UNDER CURB AND GUTTER.
- IF PRESENT, STREET LIGHT, SIGNAL AND INTERCONNECT CONDUIT OR DIRECT BURIED STREET LIGHT WIRING MUST BE EXPOSED FOR INSPECTION PRIOR TO POUR

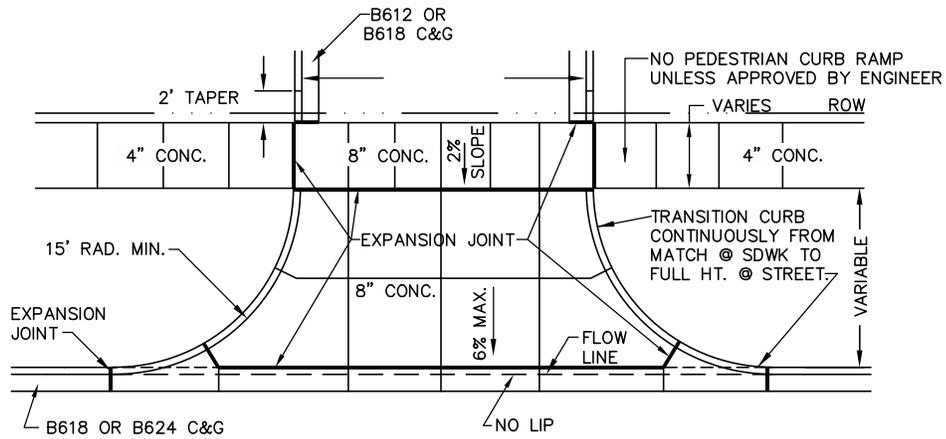

**100 – NONRESIDENTIAL DRIVEWAY APPROACH
WITH BOULEVARD SIDEWALK**

100 - Drwy (Commercial).dwg 5/2015

H:\Cad_Cmn\Details Updated\0 - STREET\100 - Drwy (Commercial)



**ENGINEERING DIVISION
PUBLIC WORKS DEPARTMENT**

PLATE NAME:

100 – Drwy (Commercial)

LAST REVISED: 6/5/2015

LAST REVISED BY: KBO